


Front Entry Enclosure

INSTALLATION DETAILS

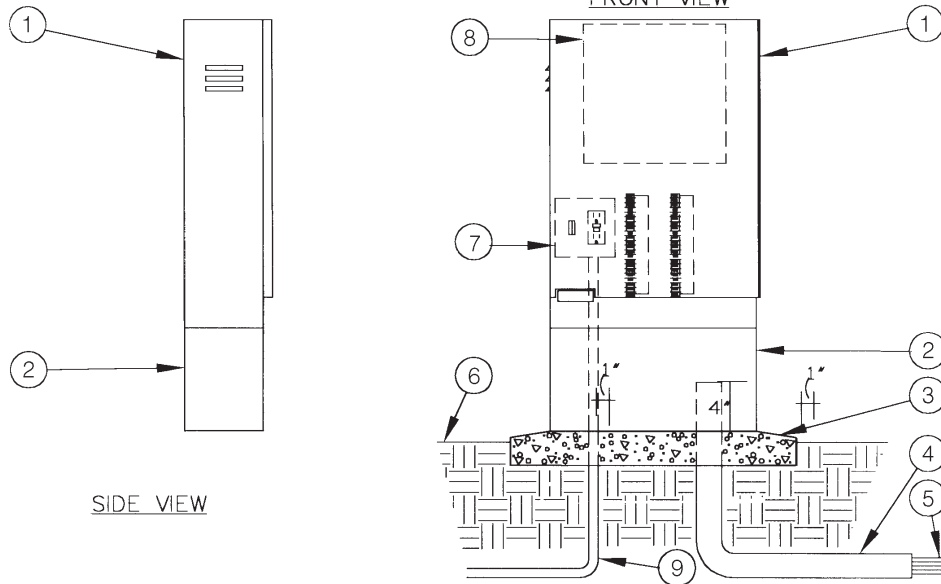

- | | |
|---|---|
| <ol style="list-style-type: none"> 1. Controller enclosure 2. Optional pedestal 3. Poured concrete base—6" min. thickness—extend concrete 6" beyond outside dimensions of enclosure with 1/2% slope for drainage 4. PVC long sweep ell—size as required | <ol style="list-style-type: none"> 5. Direct burial control wires to control valves 6. Finish grade 7. Controller sub-assembly (CSA) includes GFI & terminal strips with placards 8. Automatic controller 9. 120 volt service in conduit |
|---|---|

SPECIFICATIONS

The enclosure shall be of a vandal and weather resistant nature manufactured entirely of cold rolled steel finished with a polyester TGIC powder coating having a minimum thickness of 2.5 mils. The main housing shall be louvered upper and lower body to allow for cross flow ventilation. Filter screens shall cover all louvers to deflect against water spray, insects and dust. A cold rolled steel backboard shall be provided for the purpose of mounting electronic and various other types of

equipment. The backboard shall be mounted on four bolts that will allow for removal of the backboard. The inside door area shall provide adequate storage for plans, operating instructions and scheduling information. The enclosure door shall have a continuous stainless steel piano hinge, carriage bolted on one side, and a three-point locking mechanism on the other side. The stainless steel handle controlling the locking mechanism shall be located at the base of the door and be concealed within the

surface of the door. A stainless steel cam style lock shall be mounted in the door and a provision for a padlock shall be included within the locking mechanism. The enclosure shall be manufactured with a continuous drainage channel which mates with a teardrop shaped, hollow center, water-tight, thermoplastic door seal. The above described product shall be a NEMA 3R Rainproof Enclosure as listed by Underwriter Laboratories, Inc.